


Material Change of Use - Acoustic Overlay Under Floor Heating solution

TERRAIN

InstaCoustic overlay floor system with Polypipe Terrain overlay lite UFH system

- A. InstaCoustic 208 acoustic floor system with Polypipe Terrain overlay lite UFH
- B. Existing timber joists with square edge / t&g floor boards
- C. 1 x 12.5mm plasterboard
- D. InstaCoustic AC90/2FP Metal ceiling system incorporating acoustic hangers and IN10 acoustic insulation with 100mm (min) void

208 Floor System with Polypipe Terrain UFH Overlay System

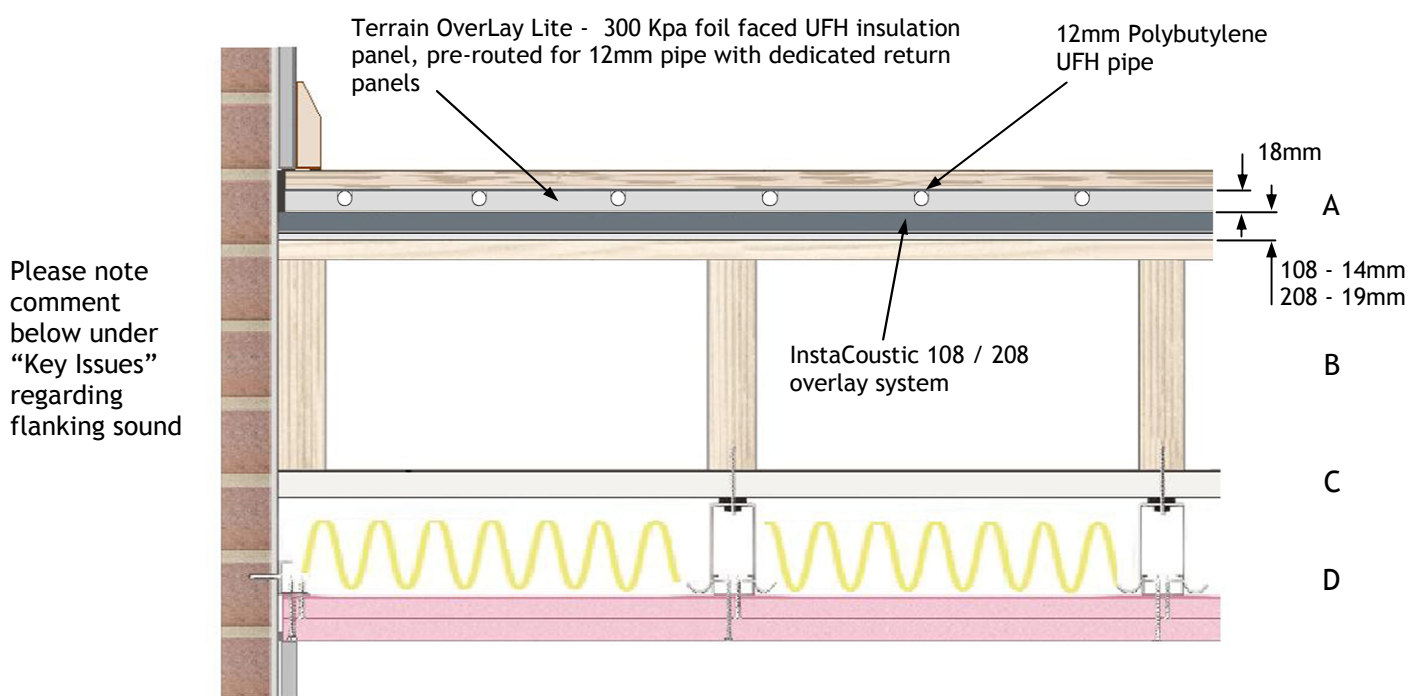

Field Sound Test Report - F62

Results	Achieved On Site	ADE Regulations
Airborne	48dB $D_nT_w + C_{tr}$	43 dB $D_nT_w + C_{tr}$

Key Issues

- 208 acoustic floor system must be isolated from the wall linings and the skirting to avoid flanking sound
- Ensure all perimeter edges are sealed including pipes/services that penetrate the floor
- Replace or repair all damaged boards
- Make sure that all existing floor boards are secured before fitting acoustic floor
- Acoustic ceiling to be fitted before the wall linings to improve performance
- If dot & dab is used, the centres of the dabs must be in accordance with the regulations
- Light weight wall constructions can cause flanking sound transmission which may bypass the floor solution. Please seek advice from the InstaCoustic Technical Team regarding suitable solutions
- Caution is required concerning floor finishes to ensure that heat transfer is not inhibited (further information and advice can be given on request)
- UFH Manifold position to be considered and agreed
- UFH system must be installed by an approved Terrain installer

Material Change of Use - Acoustic Overlay Under Floor Heating solution **TERRAIN**

Design to be in accordance with BS EN 1263 Pt. 1-3 and covered by the relevant designers professional indemnity insurance.

Terrain approved installer to carry out works and in accordance with BS EN1264: Pt. 4 where appropriate.

1. Installation / System

- A. Instacoustic 208 (20kg/m² sound barrier tiles) acoustic floor system
- B. Terrain Overlay Lite, installed over structural floor element
- C. Overlay Lite board dimensions 600 x 1245mm x 18mm, 300kPa compressive strength, thermal conductivity 0.028 W/mK
- D. Insulation panels routed @ 150mm pipe centres with applied heat diffusion foil and dedicated return panels
- E. Installation to be by approved Terrain Under floor Heating Installer

2. Pipe Work

- A. Pipe work 12mm Terrain Polybutylene with integral oxygen barrier, 5 layer Extrusion
- B. Pipe work covered by 50 year guarantee - see also BBA and WRAS approvals
- C. Each pipe work circuit shall be laid in a continuous pipe length, no joints permitted
- D. Each circuit(s) shall be sized and outputs reflect the heat loss of each heated zone
- E. Dedicated circuit(s) for each heated zone
- F. Under floor heating Pipe work within the floor of each zone shall typically be spaced at 150mm centres
- G. Both flow and return for each circuit shall terminate at the manifold locations
- H. Pipe turning from the floor and rising to the manifold shall have a bend former fitted to avoid pipe over bending and maintaining correct radius

3. Manifolds

- A. Manifold shall be stainless steel multi port to suit design and application, manifold data sheet attached
- B. Manifold Supplied with Isolating Valves, Flow Temperature adjusting Blending Valve (flow temperature setting), air vents, drain cocks
- C. Manifold body attached to wall mounting brackets with rubber isolating sleeves
- D. Flow indicators on each port/pipe circuit to enable correct commissioning and visual verification of operation
- E. Adjustable flow valves on each circuit
- F. Manifold Size dependant on number of circuits required for each apartment (See manifold data sheet for dimensions of manifold)

4. Pump Sets

- A. Pre assembled with blending valve, water blending adjustment from 35-60 Deg C
- B. Pump to be Grundfoss circulation pump or similar
- C. Option for Alpha 2L energy efficient pump available on request

Material Change of Use - Acoustic Overlay Under Floor Heating solution **TERRAIN**

5. Controls

- A. Actuators, wiring centres and thermostats will be supplied as 230v system
- B. Thermostats within public areas to be anti tamper type, Non Public areas to receive LCD 7 day time, temperature, set back, frost protection and holiday mode
- C. Switchable PI and Anti Pump Brake features as per Terrain FH.STAT.1
- D. Controls to be installed for each heated zone (room) allowing individual control of functions as stated above (not on public areas)
- E. Wiring Centre Master and Slave to be located adjacent to manifold(s) locations.
- F. All electrical wiring by controls specialist/electrical contractor

6. Standards / Approvals

- A. Manufacturing Quality Assurance in accordance with BS EN ISO 9001-2000
- B. Polypipe Polybutylene barrier pipe are covered by BBA Certificate No. 00/3699
- C. British Gas has accepted the Polypipe Class S Polybutylene pipe system as being acceptable for open vented and sealed central heating systems and is eligible for acceptance onto Three Star Central Heating System Cover
- D. British Standard Class S rated BS7291 Part 1 and Kitemark license number 38148 to BS7291 part 2 Listed in the WRAS Water Fittings and Materials Directory KIWA/KOMO Certificate numbers K14341,14342 and 14343
- E. Polypipe is a member of the Polybutylene Piping Systems Association, which is a recognised association of companies whose aim is to promote the features, benefits and best practice installation techniques of polybutylene pipe systems.
- F. UHMA - Polypipe are full members of the Under floor Heating Manufacturers Association.
- G. Polypipe have been awarded the **Carbon Trust Standard**, awarded to organisations that have measured, managed and genuinely reduced their carbon emissions.

Floor Finishes

Please note that the thermal efficiency of the floor system will be dependant upon the type of floor finishes laid. The following points should be considered when choosing floor finishes:

Carpet

It is advisable not to use a carpet that has a TOG rating of over 2, this should also include the underlay being used. Normally 80% wool type carpets provide a lower TOG rating or thermal resistance than artificial man-made fibres.

Ceramic Tiles

Ceramic tiles transfer the heat well. Please refer to the InstaCoustic adhesive specification which refers to the type of anti fracture mat and flexible adhesive for ceramic tiles.

Wood Floors

We would suggest that a 8mm to 14mm engineered hardwood system should be used. This is important because the thickness/density of the hardwood floor directly affects the thermal resistance.